



FOOTINGS

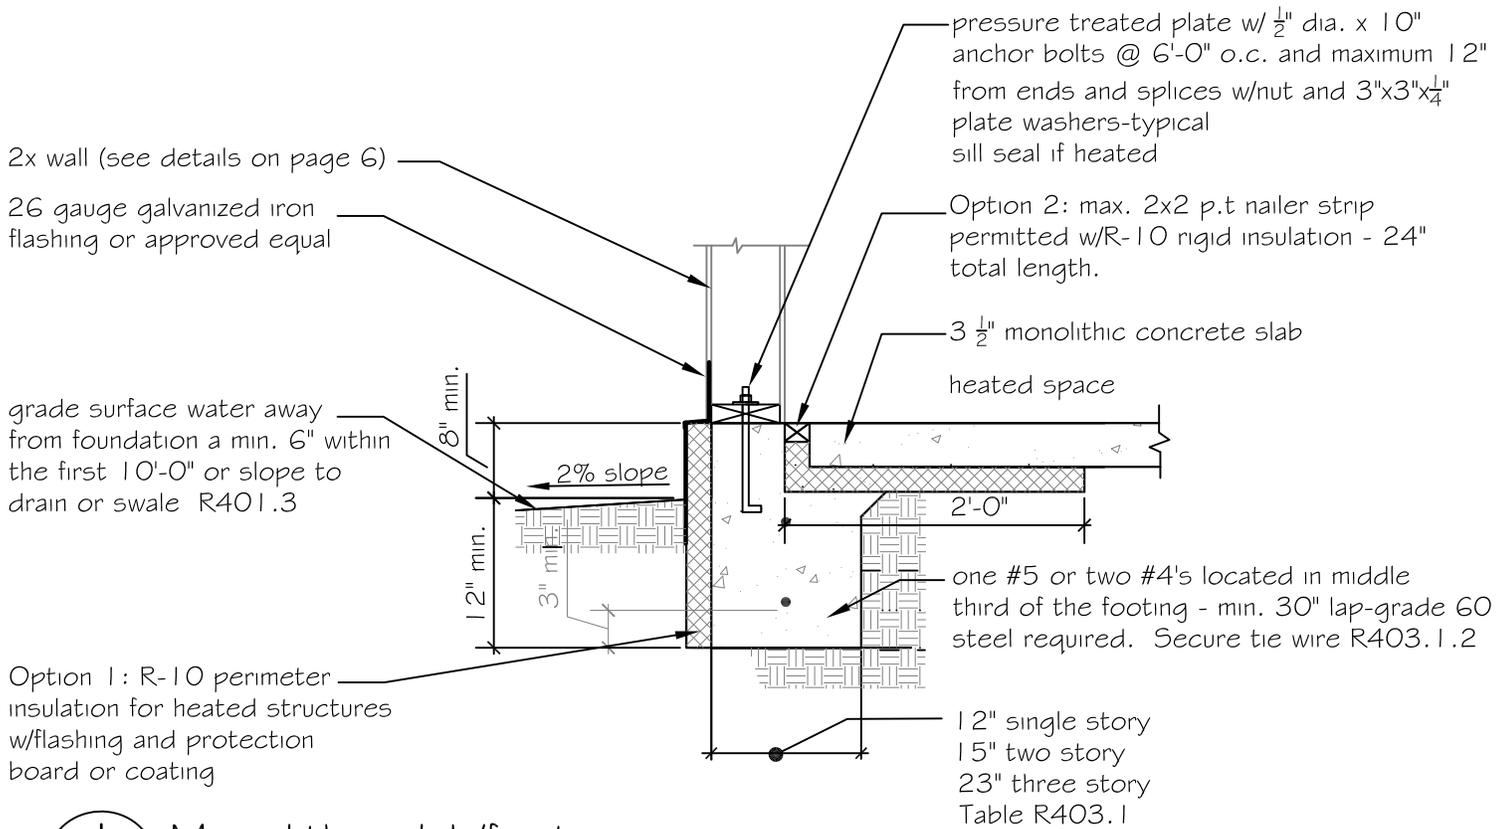

1 Monolithic slab/footing

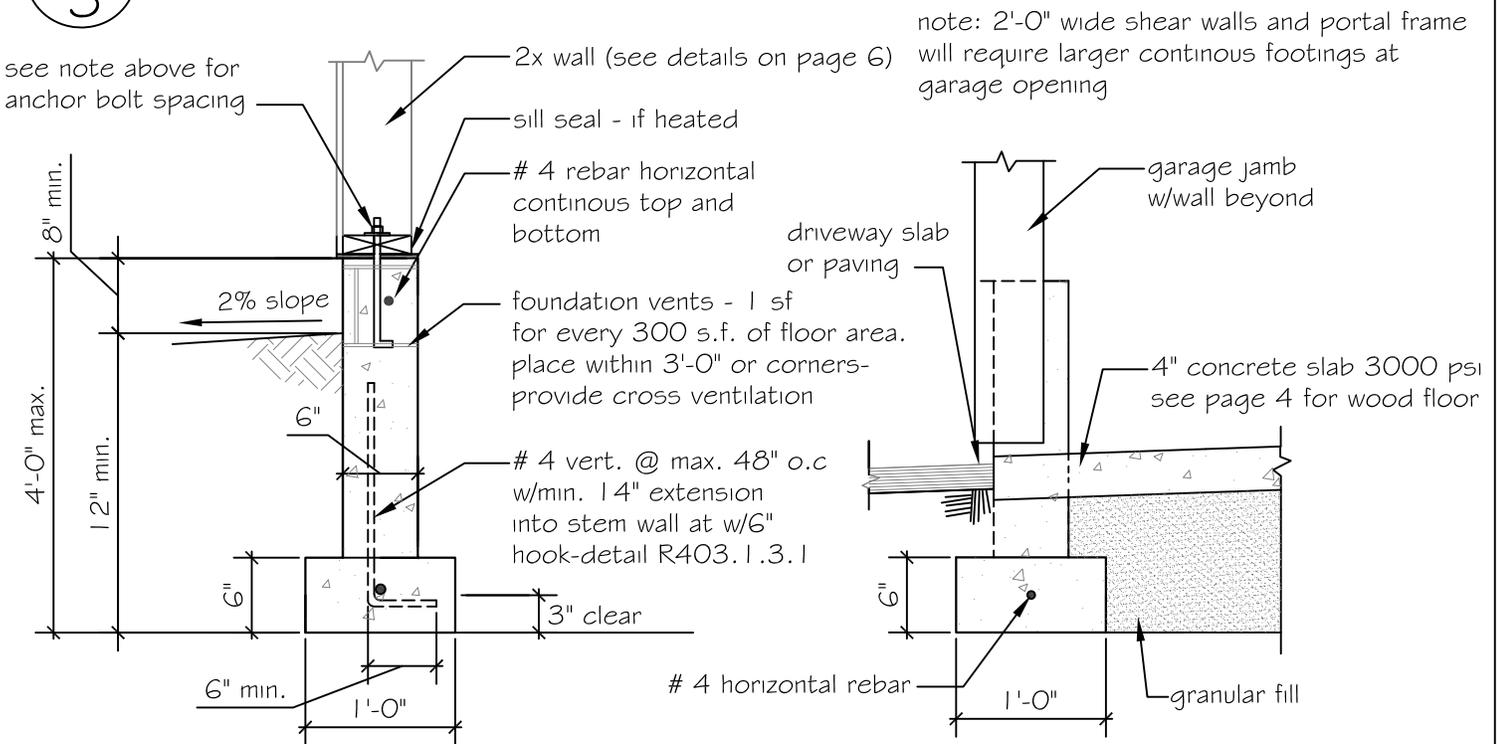

2 Footing with stem wall

3 Footing at door opening

NOTE: * Footings over 4'-0" high are required to be designed as retaining walls
* Minimum concrete strength 2500 p.s.i. Lap rebar min. 40 diameters at splices-secure with tie wire